


NOTE:
ANY SUBDRAIN UNDER THE SEWER
SHALL BE REPLACED SUCH THAT
NO FLOW SHALL ENTER THE
WATER LINE TRENCH.

SECTION A-A

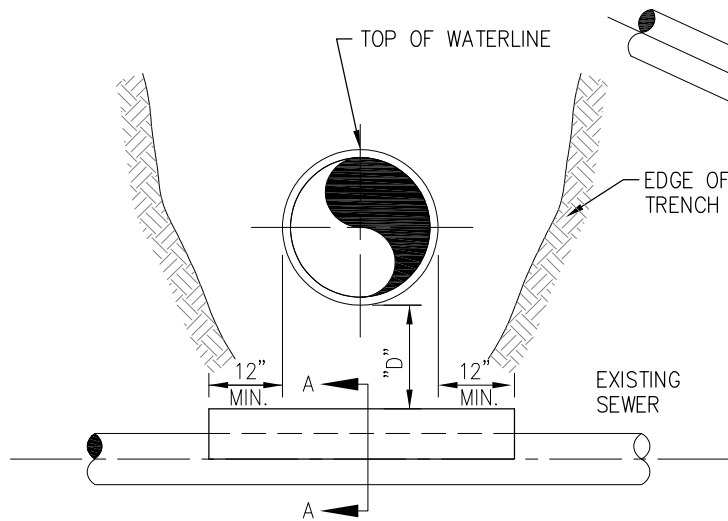

WITH "D" LESS THAN 2'

SEWER CROSSING
PLAN

NOTE:
ALL EXISTING SEWER DAMAGED DURING INSTALLATION
MUST BE REPLACED WITH PVC PIPE.



STANDARDS &
SPECIFICATIONS

REVISED:

STORM SEWER AND
SANITARY SEWER
CROSSING

DATE:

DRAWING NO. 300-12